



CONSTRUCTION NOTES

1. DRAIN ROCK SHOULD BE INSTALLED AS FAR BACK UNDER THE LOW ELEVATED STRUCTURE AS POSSIBLE. DISTANCE DEPENDS ON ACCESSIBILITY UNDER THE STRUCTURE. THE DRAIN ROCK SHOULD EXTEND 12" PAST THE EDGE OF THE STRUCTURE.
2. WASHED 3/4" TO 1 1/2" DRAIN ROCK OR COBBLE IS RECOMMENDED FOR THIS TREATMENT. NATIVE ROCK CAN BE SUBSTITUTED IF AVAILABLE. UTILIZE RIP RAP ON STEEPER SLOPES.
3. CONTAINMENT BORDERS ARE REQUIRED. OPTIONS FOR MATERIALS INCLUDE PRESSURE TREATED LUMBER, REDWOOD, RECYCLED COMPOSITES, BRICK, STONE, COBBLE, OR OTHER LANDSCAPE EDGING MATERIAL. COMBUSTIBLE MATERIALS SHALL NOT CONNECT TO ADJACENT STRUCTURES.
4. CONSULT WITH YOUR LOCAL FIRE PROTECTION DISTRICT WHEN LANDSCAPING NEAR STRUCTURES. VISIT WWW.LIVINGWITHFIRE.INFO FOR GUIDELINES ON THE DEFENSIBLE SPACE ZONE.
5. FINISH GRADE OF DRAIN ROCK SHALL BE AT LEAST 6" BELOW WOOD SIDING TO MAINTAIN WOOD AND EARTH SEPARATION REQUIRED BY LOCAL BUILDING CODES.
6. REMOVE PINE NEEDLES AND ACCUMULATED SEDIMENT TO MAINTAIN FULL FUNCTION. KEEP AREA CLEAR OF STORED MATERIALS SUCH AS FIREWOOD, LUMBER, HOUSEHOLD ITEMS, ETC.

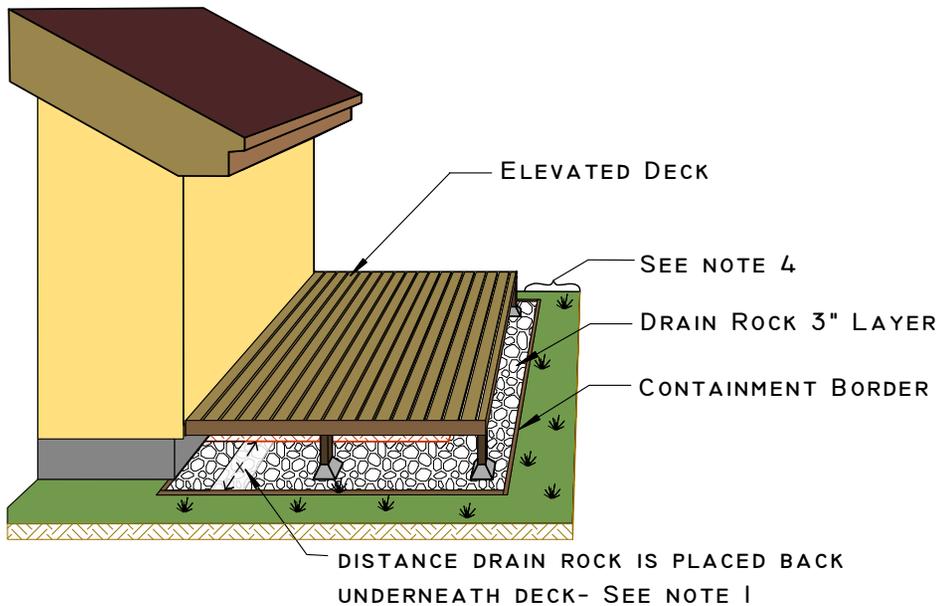

INSTALLATION GUIDELINES

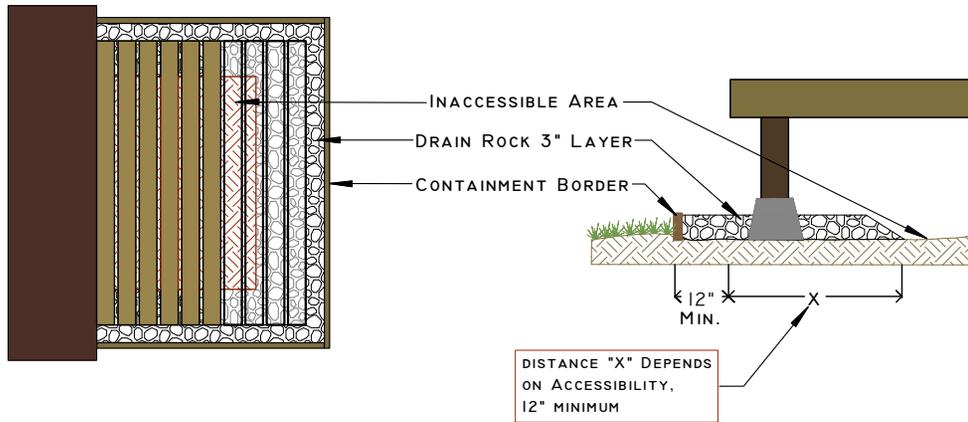

U.S. DEPARTMENT OF AGRICULTURE			
NATURAL RESOURCES CONSERVATION SERVICE			
IN COOPERATION WITH			
TAHOE RESOURCE CONSERVATION DISTRICT, AND NEVADA TAHOE CONSERVATION DISTRICT			
DRAWN BY:	DATE	APPROVED BY:	DATE
DMGG	12-5-06		

THIS SPECIFICATION IS BASED ON A REFERENCE TO THE NRCS STANDARD PRACTICE 570 - RUNOFF MANAGEMENT SYSTEMS. USERS OF THESE DRAWINGS AND ASSOCIATED INFORMATION MUST BE QUALIFIED PERSONNEL, TRAINED TO INTERPRET AND ADAPT TECHNOLOGY ACCORDING TO LOCAL CONDITIONS. DIMENSIONS AND SIZING ON THIS DOCUMENT RELAY MINIMUM REQUIREMENTS FOR THE BMP RETROFIT ORDINANCE.